


18 Attachment 11

Township of East Rockhill

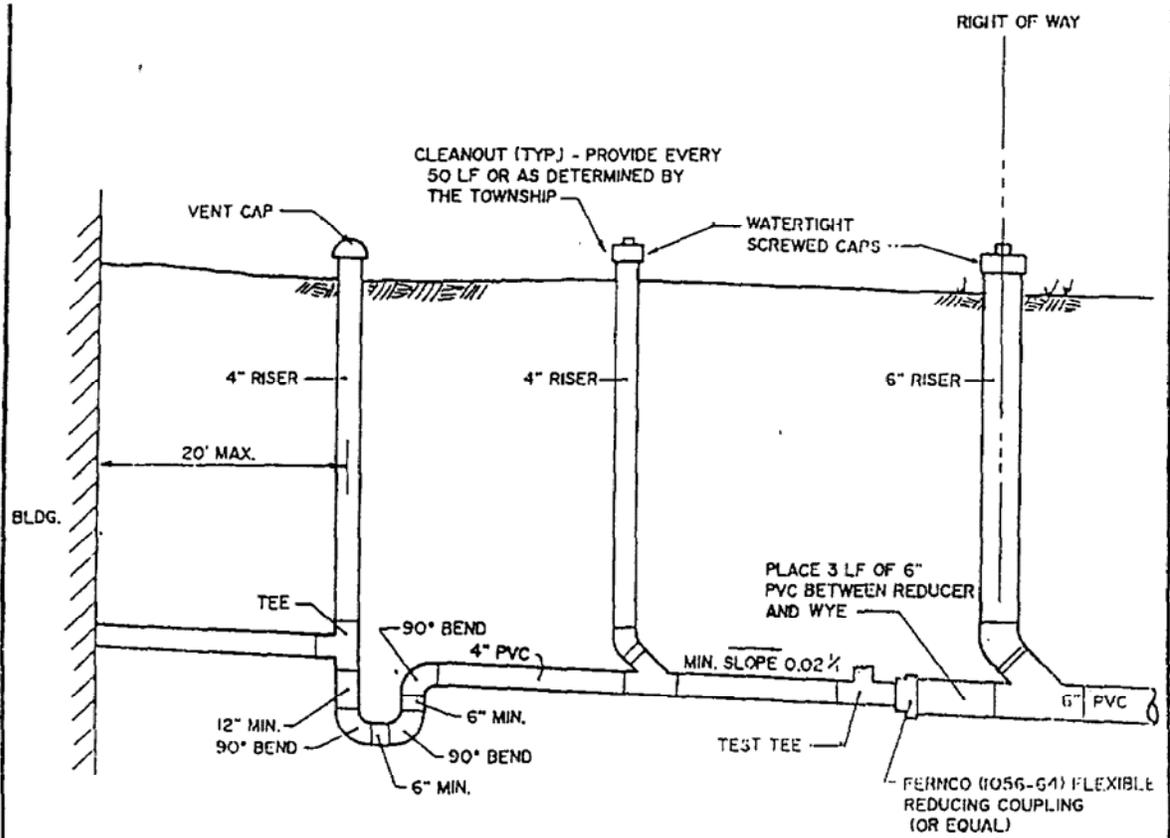

Notes:

1. Six inch bedding of 2B (AASHTO 57) stone and one foot cover of same shall be provided around all laterals within right-of-way and on-lot.
2. Backfill around all PVC riser pipes at vents and cleanouts (within right-of-way and on-lot) shall be 2A modified stone.
3. During initial installation all riser pipes shall be extended a minimum five feet above existing grade. After finish grading is performed, risers shall be cut off to a minimum height of six inches above finished grade elevation.
4. All riser pipes shall be fitted with watertight screw type caps.
5. Fernco (1056-64) reducing coupler w/0.375 rubber O-rings (or equivalent) shall be provided for reduction from 6 inch to 4 inch pipe.

EAST ROCKHILL TOWNSHIP SEWER STANDARDS

Not to Scale	TYPICAL LATERAL/CLEANOUT CONSTRUCTION (ON-LOT)	S-10
SCALE: 1/92		
DATE:		DWG No.