


18 Attachment 21

Township of East Rockhill

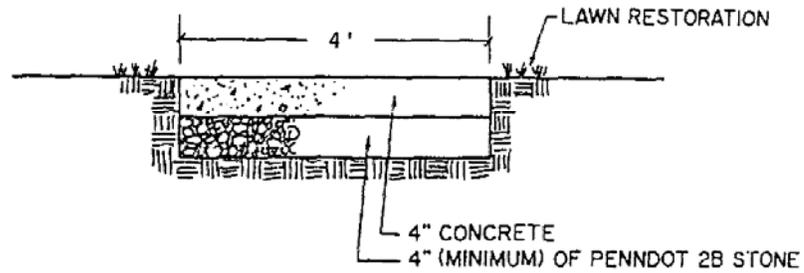

1. CONCRETE SHALL BE CERTIFIED CLASS "A" (3300 PSI) MIX
2. REFER TO APPLICABLE LAWN RESTORATION SPECIFICATIONS CONTAINED HEREIN
3. SUBGRADE SHALL BE DRY AND STABLE PRIOR TO PLACEMENT
4. SIDEWALK SHALL BE SLOPED TOWARDS THE STREET AT 1/4" PER FOOT
5. 3/8" EXPANSION MATERIAL SHALL BE PROVIDED EVERY 20 LF
6. 1/4" SCORE CONTROL JOINT SHALL BE PROVIDED EVERY 5 LF

EAST ROCKHILL TOWNSHIP SEWER STANDARDS

Not to Scale	TYPICAL SIDEWALK RESTORATION	S-20
SCALE:		
DATE:		
	DWG. No.	