
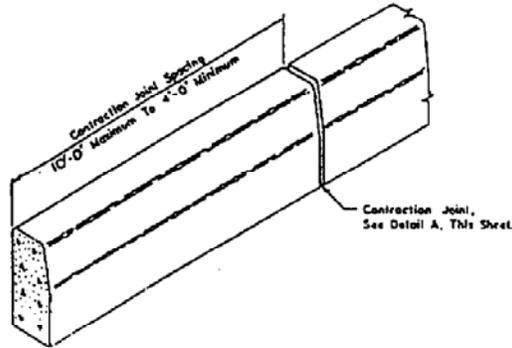


18 Attachment 22

Township of East Rockhill

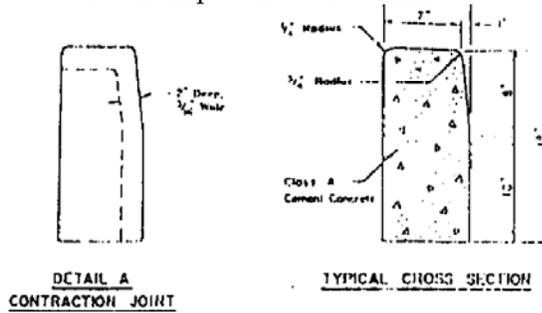

NOTES: PLAIN CEMENT CONCRETE CURB

1. Provide 3/4 inch expansion material every 30 l.f. along straight runs; every 10 l.f. around radii at intersections; at structures; and between curblines and driveway aprons.
2. All construction and materials shall conform to PennDOT Form 408 specifications unless otherwise noted and as directed by the Township.
3. 5 foot end of curb treatments shall be provided where curblines terminate.
4. Rebar steel reinforcement shall be provided at all structures, inlets, and across curb depressions as directed by the Township.
5. Overcut subgrade shall be brought back to grade utilizing 2B stone.

EAST ROCKHILL TOWNSHIP SEWER STANDARDS

Not To Scale SCALE:	STANDARD CURB RESTORATION REQUIREMENTS	S-21
DATE: 1/92		DWG. No.