



EAST ROCKHILL CODE

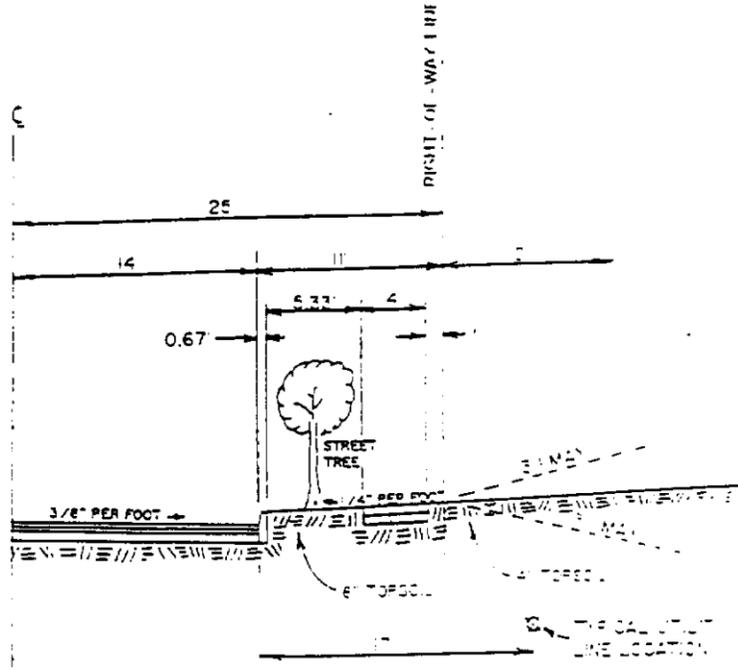

TYPICAL ROADWAY HALF-SECTION

50 FEET RIGHT-OF-WAY WITH 28 FEET WIDE CARTWAY, WITH CURB AND SIDEWALK


SUBDIVISION AND LAND DEVELOPMENT

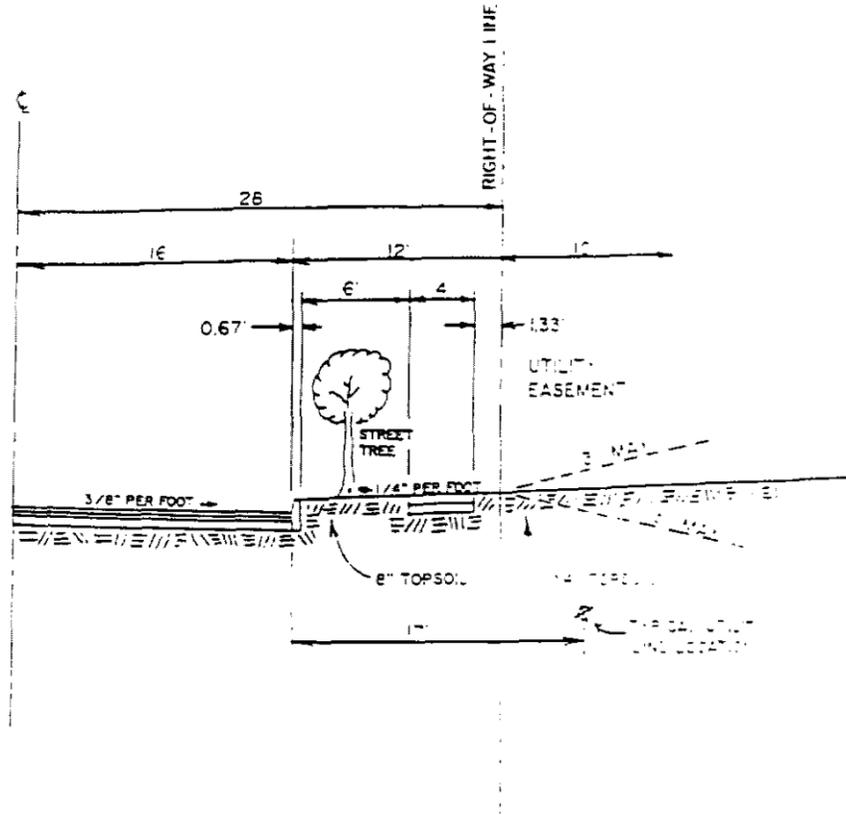

TYPICAL ROADWAY HALF-SECTION

56 FEET RIGHT-OF-WAY WITH 32 FEET WIDE CARTWAY, WITH CURB AND SIDEWALK


EAST ROCKHILL CODE

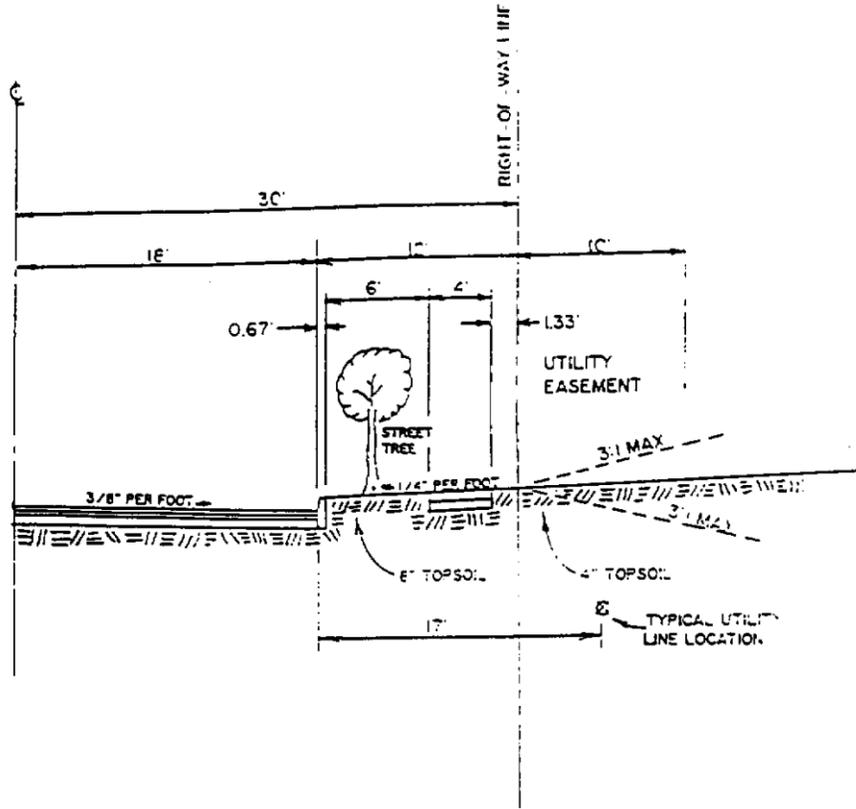

TYPICAL ROADWAY HALF-SECTION

60 FEET RIGHT-OF-WAY WITH 36 FEET WIDE CARTWAY, WITH CURB AND SIDEWALK

SUBDIVISION AND LAND DEVELOPMENT

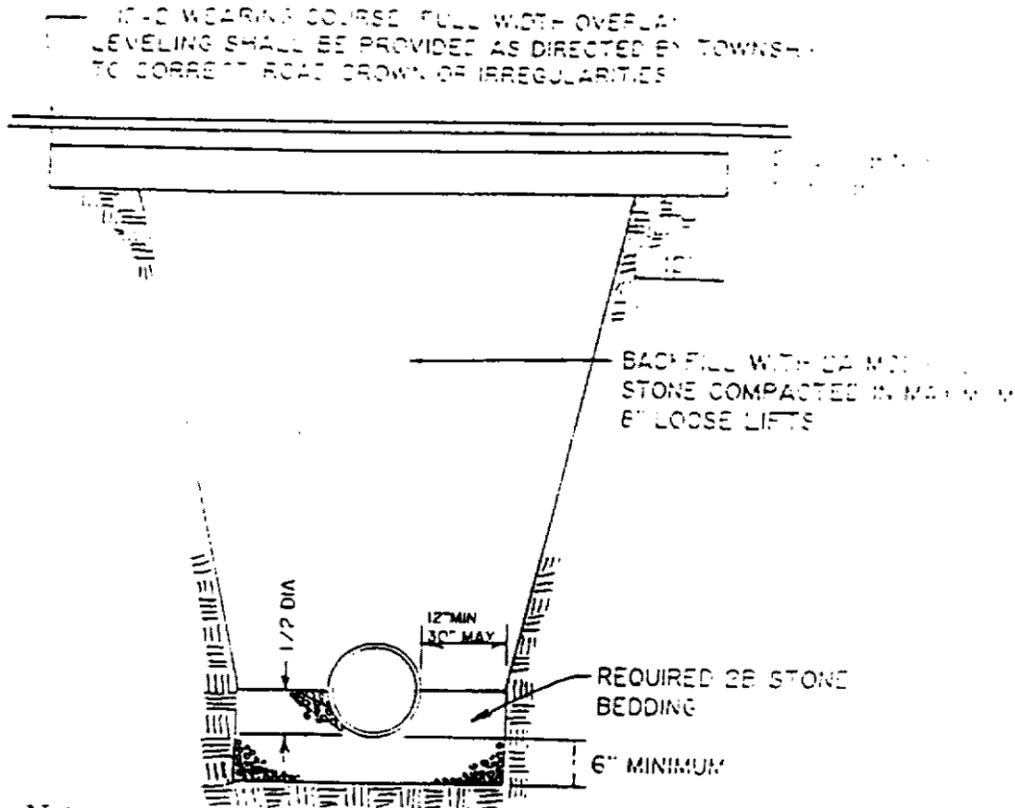

Notes:


1. Developer/contractor shall be responsible for proper implementation of safety requirements in conformance to the Federal and State Department of Labor and Occupational Safety and Hazard Administration Regulations.
2. Backfill for new road construction may be select earth backfill when suitable material is available as determined by the Township.
3. Full depth 2A stone backfill shall be required for all storm sewer, sanitary sewer and utility trenching when edge of trench is within 15 feet of existing roadway edge of paving; and for all trenching within area of roadway widening.
4. Roadway crown shall 3/8 inch per foot.
5. 3 inch temporary patch of BCBC shall be provided and maintained for less than 30 days prior to final restoration of existing roadway or driveway. Temporary patch shall be removed with final restoration performed no more than 90 days from date of sewer installation providing testing has been satisfactorily accomplished and no settlement has occurred.

(Ord. 158, 12/20/1995, App. A)

STORM SEWER BEDDING DETAIL

(WITHIN RIGHT-OF-WAY, BENEATH ALL EXISTING
ROADWAYS AND DRIVEWAYS, PUBLIC OR PRIVATE.)

EAST ROCKHILL CODE

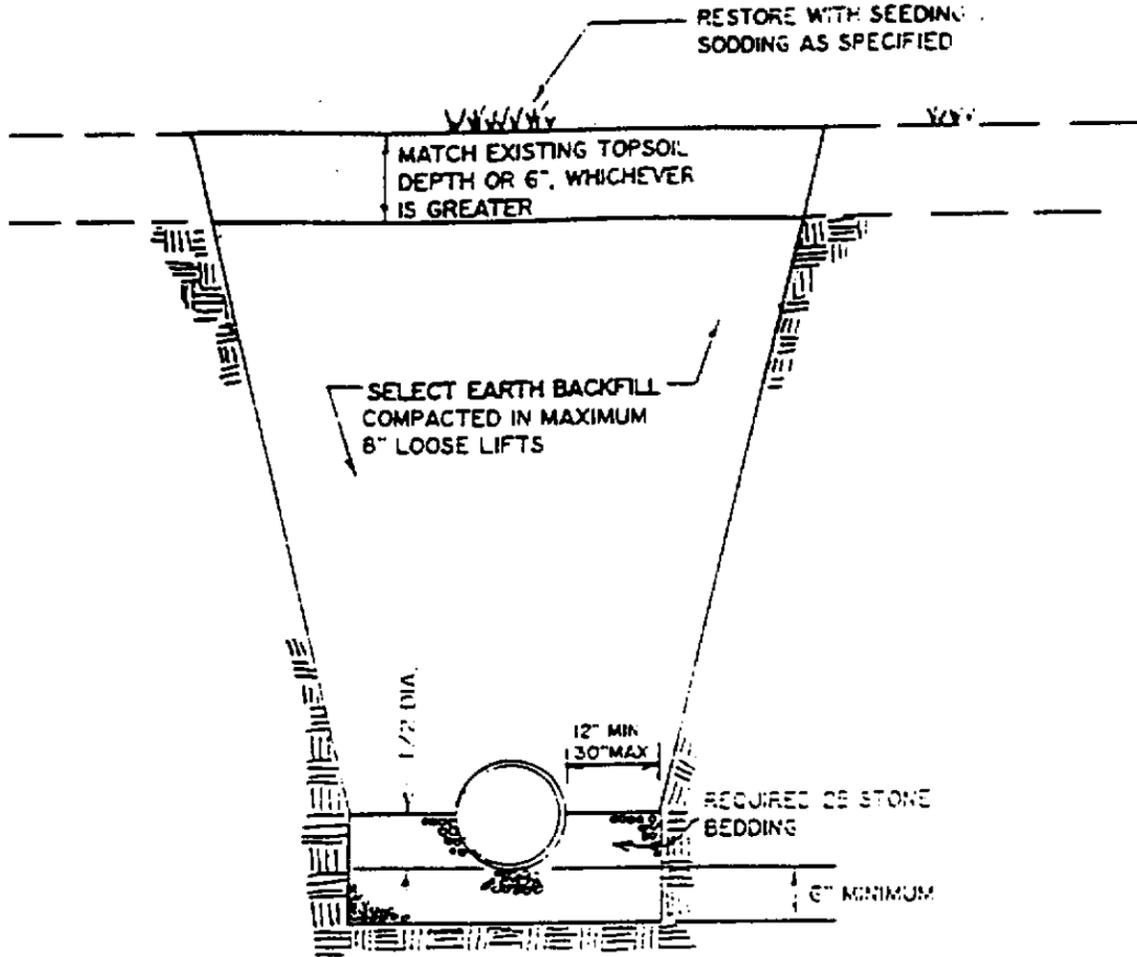

STORM SEWER BEDDING DETAIL

(EARTHEN AREA)